



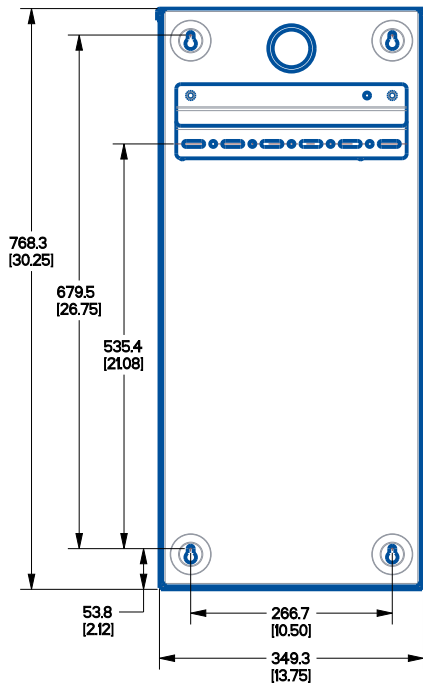



TRANSFER SWITCH
(IF SUPPLIED)

HOLE LOCATIONS FOR
OPTIONAL MOUNTING TO
A CONCRETE PAD

12 (0.47) DIA. CLEARANCE
HOLE (4) PLACES,
10 (3/8) DIA. MASONRY ANCHOR
BOLTS RECOMMENDED

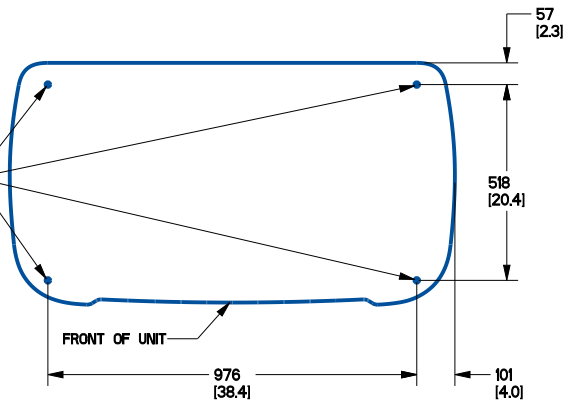

MOUNTING TO CONCRETE PAD

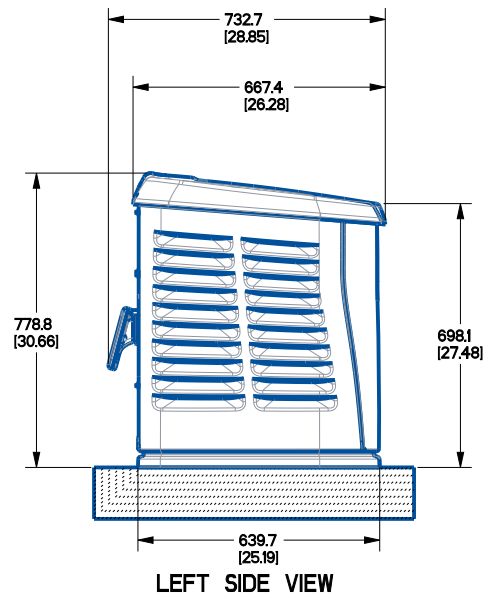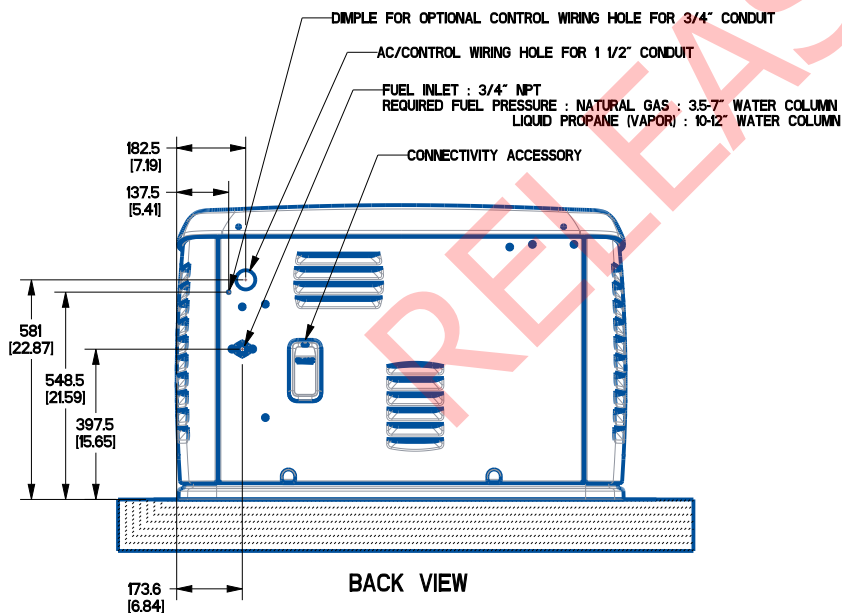


INSTALLATION DRAWING

TITLE


INSTALL GENERATOR HSB

SIZE	CAGE NO	DWG NO	REV
A	N/A	A0005736586	B
SCALE	NTS	WT-KG	N/A
SHEET	1	of	2


ALL DIMENSIONS IN:
MILLIMETERS (INCHES)

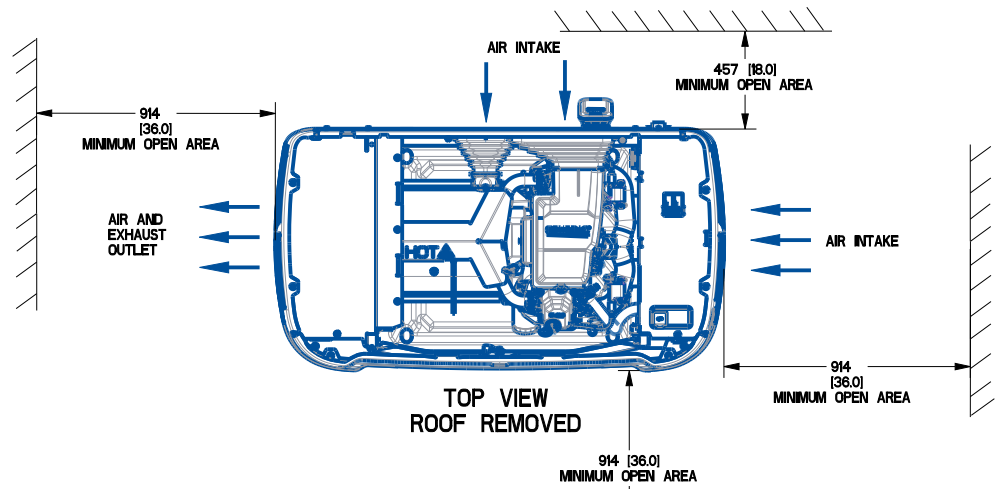



"DO NOT LIFT BY
ROOF OR LOUVERS"

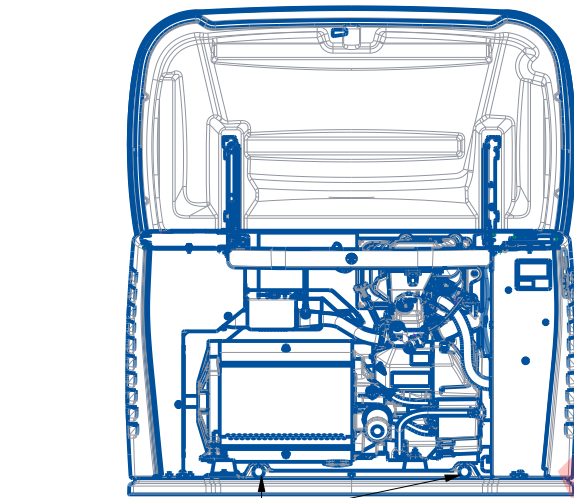

FRONT VIEW
FRONT PANEL REMOVED
ROOF OPENED

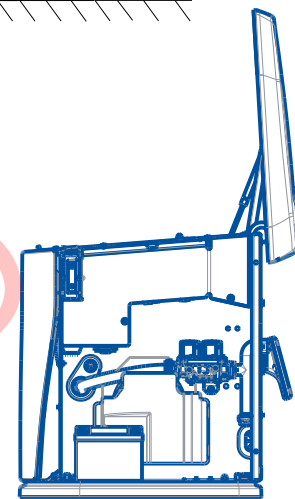

RIGHT SIDE VIEW
INTAKE PANEL REMOVED

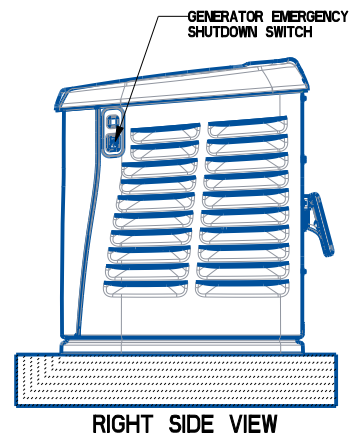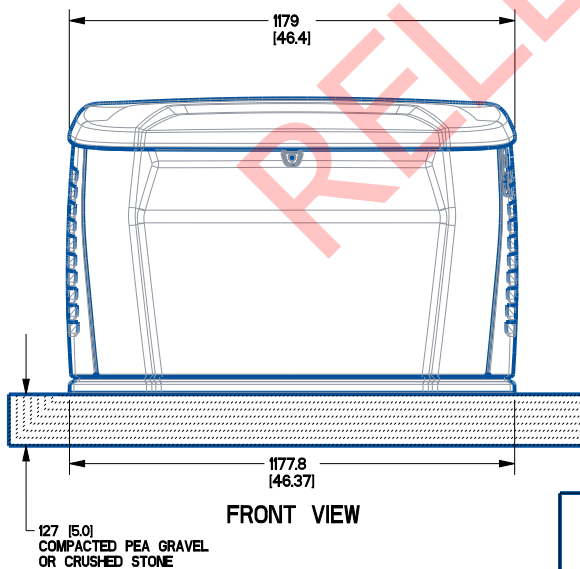

INSTALLATION DRAWING

TITLE

INSTALL GENERATOR HSB

SIZE A	CAGE NO N/A	DWG NO A0005736586	REV B
SCALE NTS	WT-KG N/A	SHEET 2 of 2	

ALL DIMENSIONS IN:
MILLIMETERS [INCHES]